



* But not less than one full course over highest entering pipe.

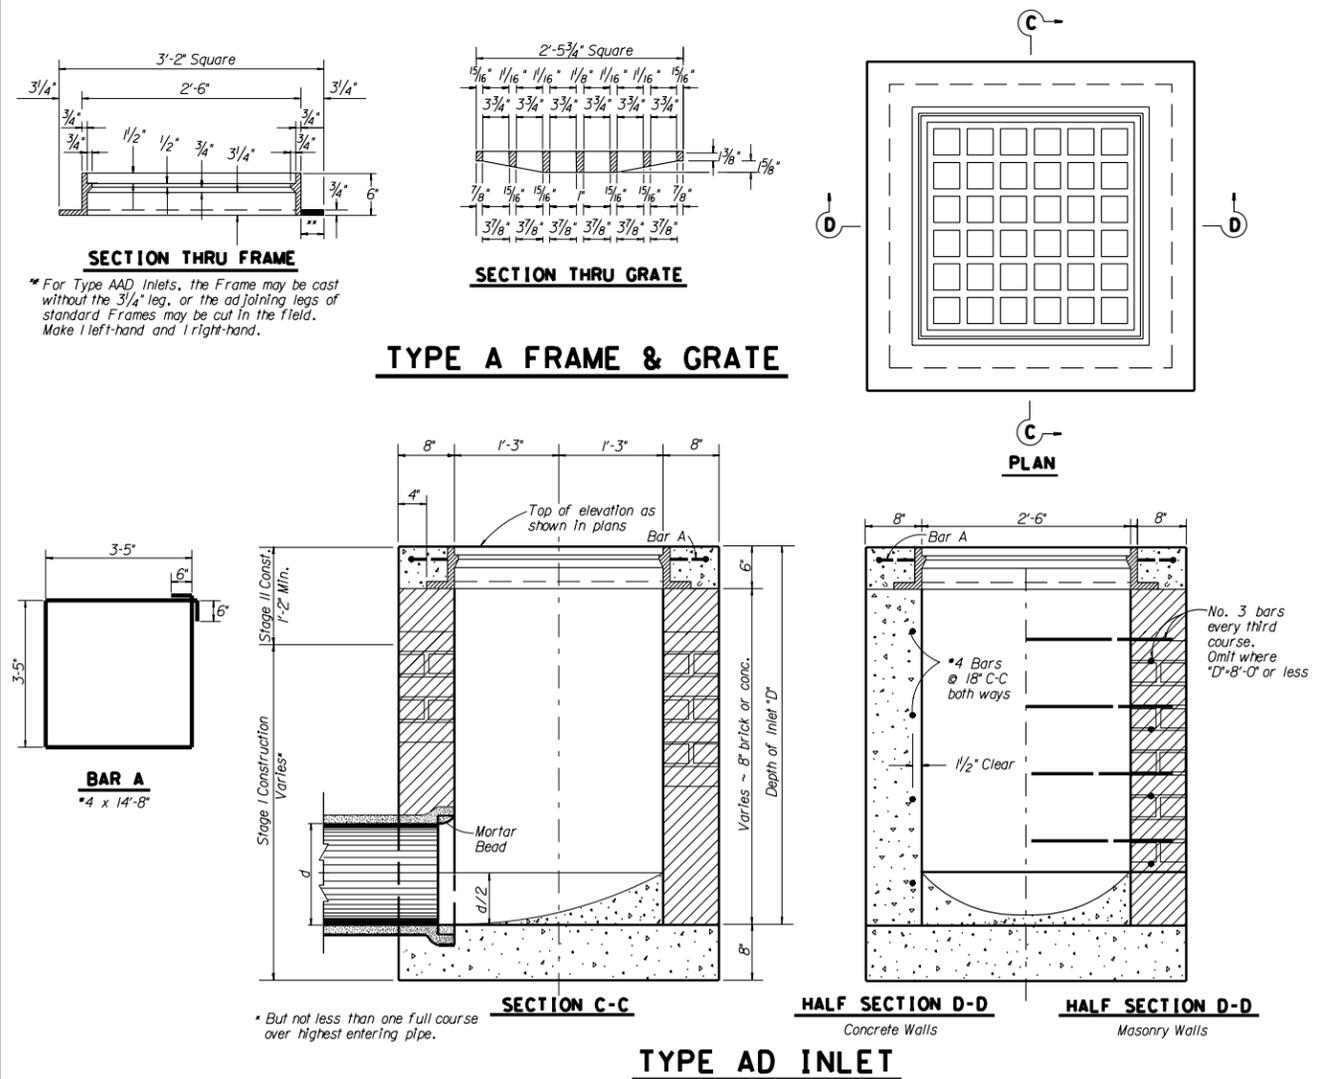

* But not less than one full course over highest entering pipe.

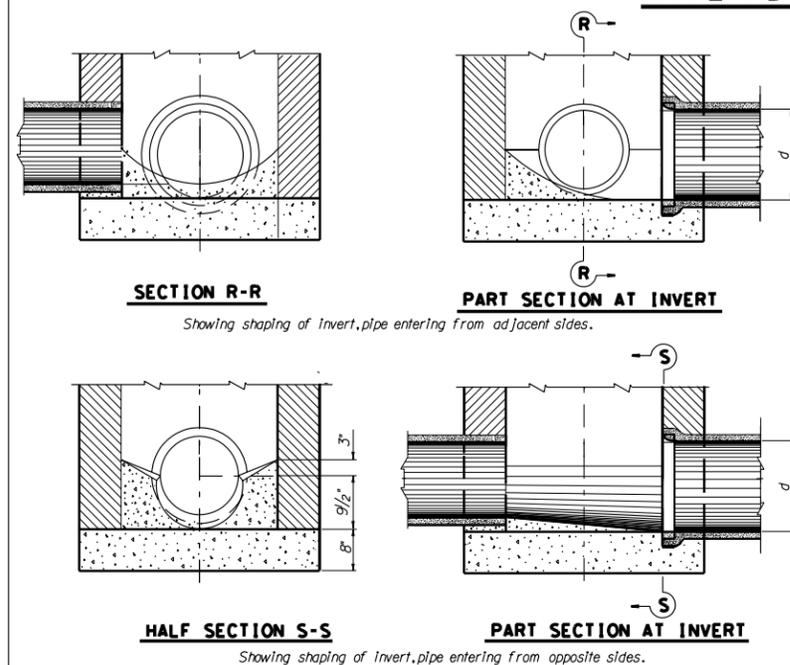

GENERAL NOTES:

Equip Type AD Inlets with Type A Frame and Type AD Grate.

Where size of pipes passing through inlet exceeds 30", increase inside width of diameter of pipe and slope walls from horizontal diameter of pipe to 2'-6" at top.

Provide and place Cast Iron Manhole steps (See Manhole Details) spaced at 18" centers and located on wall as directed where "D" exceeds 5'-0".

Build Type AD & AAD Inlets to Stage I and finish after all grading operations are substantially completed.

Use Ductile Iron for Type AD Grates. Type A Frames and Grates may be Gray Cast Iron.

Consider the furnishing and installation of Cast Iron I-Beams subsidiary to pertinent items.

Texas Department of Transportation
Austin District Design

**DROP INLET DETAILS
TYPE AD & AAD**

Austin District Standard

© TxDOT 2003	DIST	FED REG	FEDERAL AID PROJECT	SHEET
REVISIONS	AUS	6		
3/03 District Update	COUNTY		CONTROL	SECT
9/04 2004 Update			JOB	HIGHWAY