



LONGITUDINAL SECTION FOR CIRCULAR & ARCH PIPES

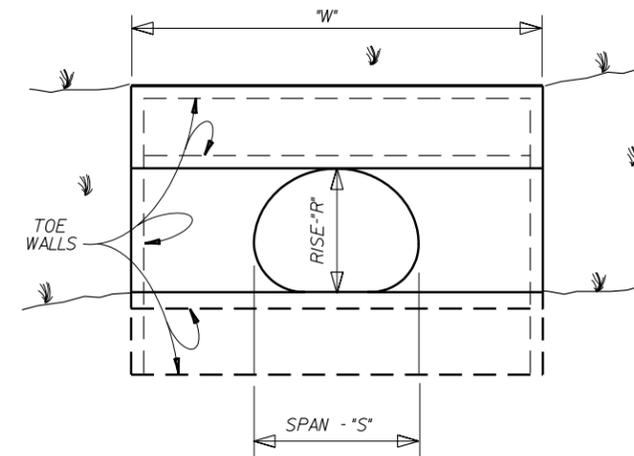

SINGLE C.M.P. ARCH PIPE CULVERT

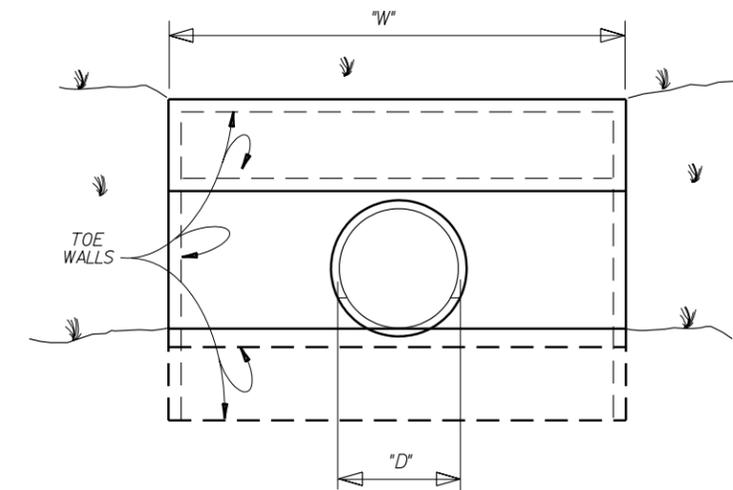


SINGLE CIRCULAR PIPE CULVERT (CMP or RCP)


DIMENSIONS FOR CIRCULAR (CMP and RCP) PIPE CULVERTS

"D" INSIDE DIA. of PIPE	"L"	"G"		SINGLE	DOUBLE	TRIPLE	QUADRUPLE
		CGM	RCP				
18"	2'-0"	1'-2"	0'-9"	4'-6"	7'-2"	9'-10"	12'-6"
21"	2'-6"	1'-3"	0'-10"	5'-3"	8'-4"	11'-4"	13'-4"
24"	3'-0"	1'-5"	0'-11"	6'-0"	9'-5"	12'-10"	16'-3"
30"	4'-0"	1'-8"	1'-1"	7'-6"	11'-8"	15'-10"	20'-0"
36"	5'-0"	1'-11"	1'-3"	9'-0"	13'-11"	18'-10"	23'-9"
42"	6'-0"	2'-2"	1'-5"	10'-6"	16'-2"	21'-10"	27'-6"
48"	7'-0"	2'-5"	1'-7"	12'-0"	18'-5"	24'-10"	31'-3"
54"	8'-0"	2'-10"	1'-11"	13'-6"	20'-10"	28'-2"	35'-6"
60"	9'-0"	3'-2"	2'-0"	15'-0"	23'-2"	31'-4"	39'-6"

"G" IS MEASURED BETWEEN THE OUTER SURFACES OF THE PIPES.

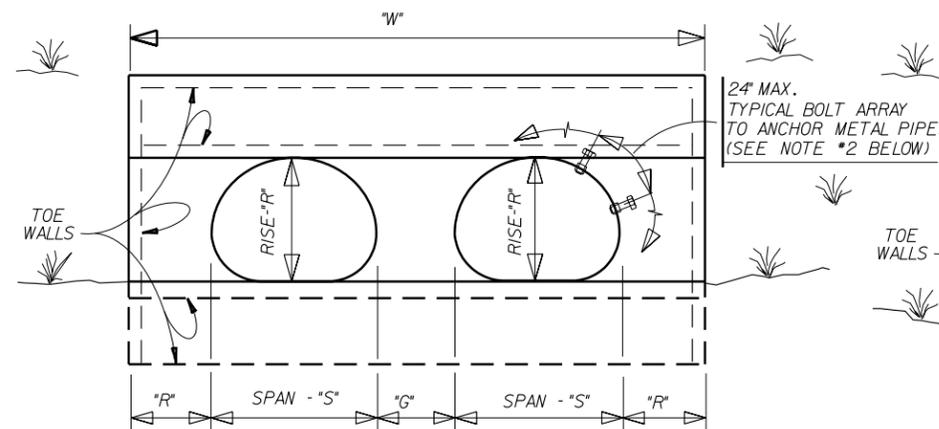

MULTIPLE C.M.P. ARCH PIPE CULVERT

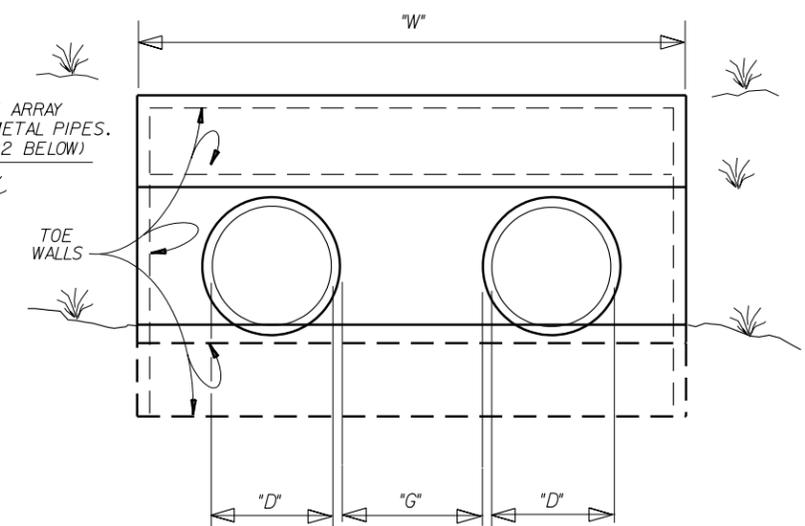

MULTIPLE CIRCULAR PIPE CULVERT (CMP or RCP)

DIMENSIONS FOR C.M.P. ARCH PIPE CULVERTS

DESIGN SIZE	APPROX. ARCH DIM.		"L"	"G"	SINGLE	DOUBLE	TRIPLE	QUADRUPLE
	SPAN "S"	RISE "R"						
2	21"	15"	2'-0"	1'-2"	4'-3"	7'-2"	10'-1"	13'-0"
3	28"	20"	3'-0"	1'-5"	5'-8"	9'-5"	13'-2"	16'-11"
4	35"	24"	4'-0"	1'-8"	6'-11"	11'-6"	16'-1"	20'-8"
5	42"	29"	5'-0"	1'-11"	8'-4"	13'-9"	19'-2"	24'-7"
6	49"	33"	6'-0"	2'-2"	9'-7"	15'-10"	22'-1"	28'-4"
7	57"	38"	7'-0"	2'-5"	11'-1"	18'-3"	25'-5"	32'-7"
8	64"	43"	8'-0"	2'-10"	12'-5"	20'-8"	28'-10"	37'-0"
9	71"	47"	9'-0"	3'-2"	13'-9"	22'-10"	31'-11"	41'-0"

BASED ON 2-2/3" X 1/2" CORRUGATION

"G" IS MEASURED BETWEEN THE OUTER SURFACES OF THE PIPES.

NOTES:

- 1.) FOR RIPRAP QUANTITIES AND SLOPES, SEE CULVERT LAYOUT SHEET. CONCRETE SHALL BE CLASS B UNLESS OTHERWISE SHOWN IN THE PLANS.
- 2.) ALL METAL PIPES (CIRCULAR AND/OR ARCH) SHALL HAVE 5/8" X 6" GALVANIZED BOLTS WITH 2 HEX NUTS AT 24" CENTERS TO ANCHOR THE PIPE TO THE CONCRETE. THIS WORK WILL BE SUBSIDIARY TO THE RIPRAP HEADWALL.
- 3.) FOR CONCRETE ARCH PIPES, THE CMP ARCH PIPE CULVERT DIMENSIONS WILL HAVE TO BE ADJUSTED FOR THE PIPE WALL THICKNESS.
- 4.) FOR PIPES LARGER THAN SHOWN, USE THE CLEAR DISTANCE BETWEEN PIPES SHOWN IN ITEMS 460 AND/OR 464.
- 5.) IF THE SIDES OF THE HEADWALL IS ADJACENT TO A RIPRAP SLOPE AND IF THE TOP OF THE HEADWALL IS ADJACENT TO THE ROADWAY FOUNDATION OR RIPRAP SLOPE, THE SIDE AND TOP TOE WALLS MAY BE ELIMINATED IF APPROVED BY THE ENGINEER.

SAN ANTONIO DISTRICT STANDARD RIPRAP HEADWALL